


SECTION

MINIMUM SIDEWALK WIDTHS

5' MINIMUM, 10' MAXIMUM
SEE DESIGN STANDARDS

NOTES:

1. THRU JOINTS AND DUMMY JOINTS SHALL BE AS SHOWN ABOVE. THRU JOINTS SHALL ALSO BE PLACED IN THE SIDEWALK SECTION AT DRIVEWAY AND ALLEY RETURNS. ALL JOINTS SHALL BE CLEAN AND EDGED WITH AN EDGE HAVING 1/4" RADIUS. JOINTS SHALL BE FLUSH WITH THE FINISHED SURFACE.
2. ALL UTILITY POLES, METER BOXES, ETC. IN SIDEWALK AREAS SHALL HAVE 3/16" JOINT MATERIAL (FULL DEPTH) PLACED AROUND THEM BEFORE PLACING CONCRETE.
3. PREMOLDED JOINT FILLER SHALL BE 3/16" x 2" ASPHALT SATURATED FELT OR PAPER.
4. FORMS SHALL BE EITHER WOOD OR STEEL AND SHALL MEET ALL REQUIREMENTS OF THESE SPECIFICATIONS.
5. CONCRETE SHALL BE CLASS 3000 PSI

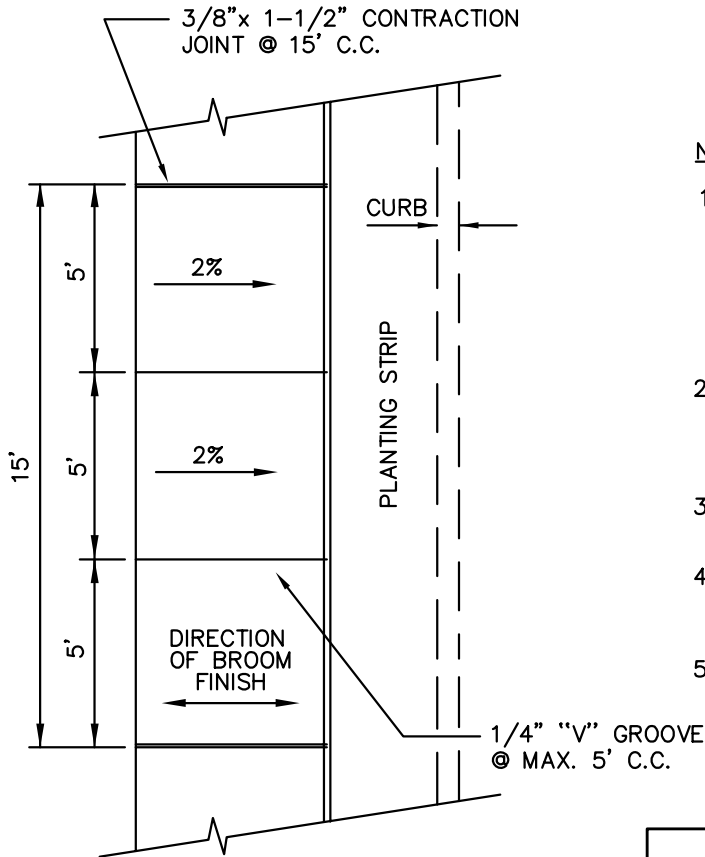

PLAN

SIDEWALK WITH PLANTING STRIP

CITY OF CASTLE ROCK			
SIDEWALK WITH PLANTING STRIP			
APPROVED:			DWG. NO.
_____			CRO13ST
BY CITY		DATE	
DATE:	DRWN:	CHKD:	SCALE:
2/06	J.H.	T.J.O.	NONE